




Red: PAINTED ITEMS
Blue: KITS

- 1. All labeled components are to be assembled before shipment unless otherwise noted.
- 2. All bearings are to be pressed in with force applied to outer ring only.
- 3. All hardware to be torqued to specs listed in chart below.
- 4. Special notes if any are shown below.

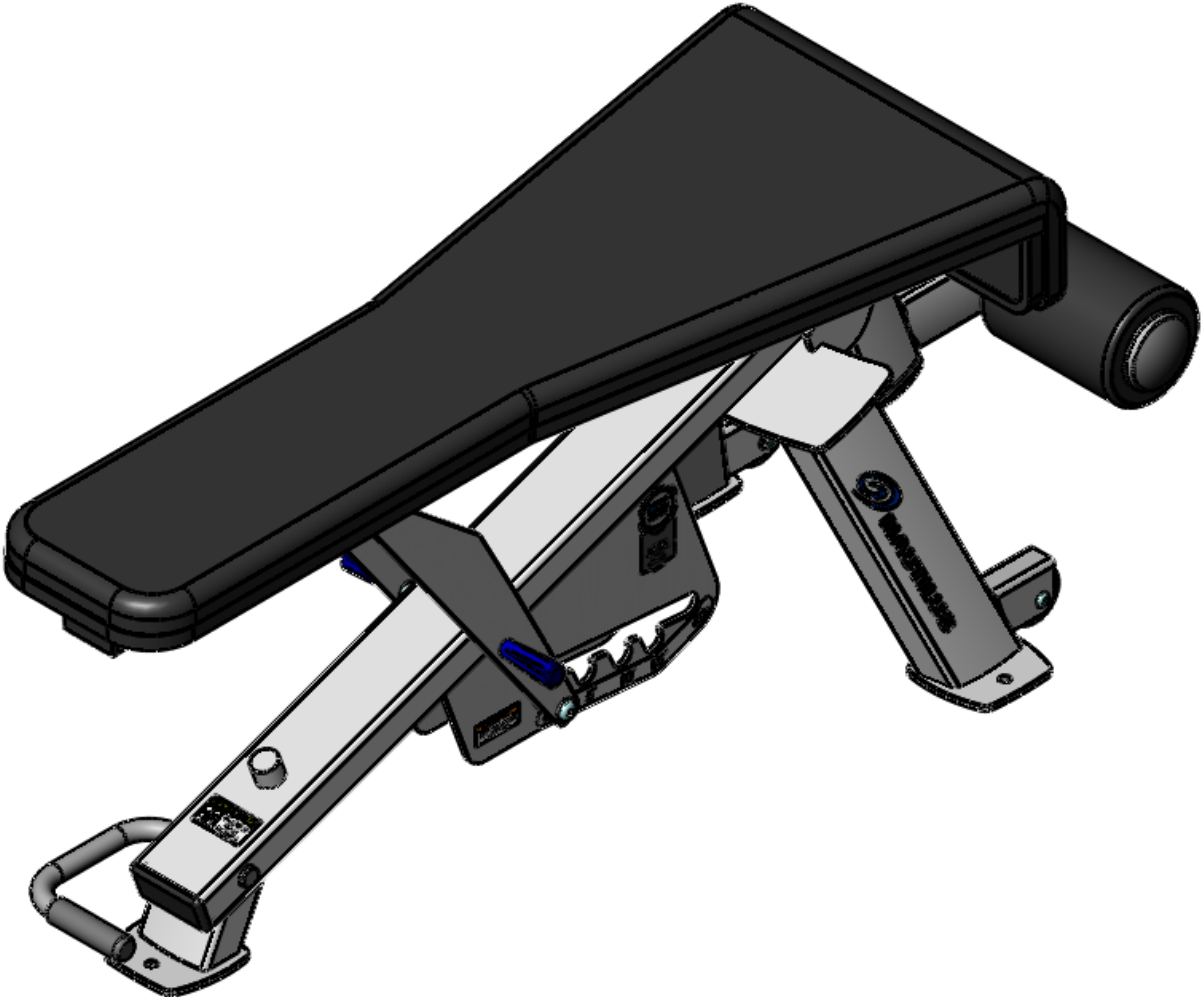

PART NO.	QTY.	DESCRIPTION
01-1105	2	3/8 -16 UNC x 1½ Bolt
01-1551	1	3/8 -16 UNC x 3¼ Bolt
01-4036	2	BOLT BH , 3/8 -16 x ¾" ZINC
01-4064	2	BOLT BH 3/8-16 X 2" ZINC
01-4075	6	BUTTON HEAD SOCKET CAP SCREW,½ -13 x 1¼" BRIGHT ZINC
03-1035	2	3/8" Lock Nut
04-5207	6	WASHER, FLAT, ½" SAE
04-5213	7	3/8" Internal Loc Washer
05-1065	4	BRASS FLANGE BUSHING .760 X 1 X 1/2
06-8285	2	1 3/4 Inv. Ext. Snap Ring
07-9787	2	BUSHING SLEEVE
09-1058	1	7/8 x 4 1/2 FOAM GRIP
09-1211	2	Plug Frame 2 X 3 "ONE"
09-1224	2	GRIP ASSEMBLY HYD SEAT ADJUSTMENT
09-2090	2	2 X 3 X 11 GA FRAME PLUG
09-3055	2	2 X 4 11 GA FRAME PLUG
09-4004	2	MOLDED UPH. ROLLER END CAP
09-5030	1	FOOTPAD MOLDED BLACK
12-1193	1	PINCH POINT WARNING DECAL
12-1380	1	Made In USA
12-1411	1	WL#6 MAX USER WEIGHT 350 LBS
12-1814	1	WARNING LABEL, GENERAL WARNING LABEL
12-5619	1	Nautilus Transfer Decal - Small BLACK
12-6036	1	Decal, F3AAB F3AD, 0 thru 20 Deg, Left
12-6037	1	Decal, F3AAB F3AD, 0 thru 20 Deg, Right
19-1291	1	SERIAL NO. DECAL
56-0071	3	SLEEVE PIVOT SEAT 090
56-0258	2	LINK MOVEMENT ARM BACKPAD
56-0260	2	WHEEL, 70mm (2.76")
56-0425	1	Sleeve
56-0427	2	Handle F3090 Adjustment
65-1302	1	SEAT ASSEMBLY F3AD
66-1304	1	F3AAB SEAT FRAME
91-999	1	Paint (1.5 lbs)
UP9940	1	UPH. BENCH PAD F2AD, F3AD
UP9955	2	UPHOLSTERY ROLLER

Customer Service & Parts 800/ 235-2233
General Parts Requests: parts@medfitsys.com
Warranty Field Service Requests: servicerequest@medfitsys.com
Med-Fit Systems, Inc. 800/ 831-7665


www.medfitsystems.com

ADJ DECLINE BENCH
F3AD

Bolt Torque Specifications		
Size	Grade 5	Grade 8
	Torque (ft-lbs)	Torque (ft-lbs)
1/4-20	8	12
1/4-28	10	14
5/16-18	17	25
3/8-16	30	45
7/16-14	50	70
1/2-13	75	110
1/2-20	90	120
5/8-11	150	220
5/8-18	180	240



Red: PAINTED ITEMS
Blue: KITS

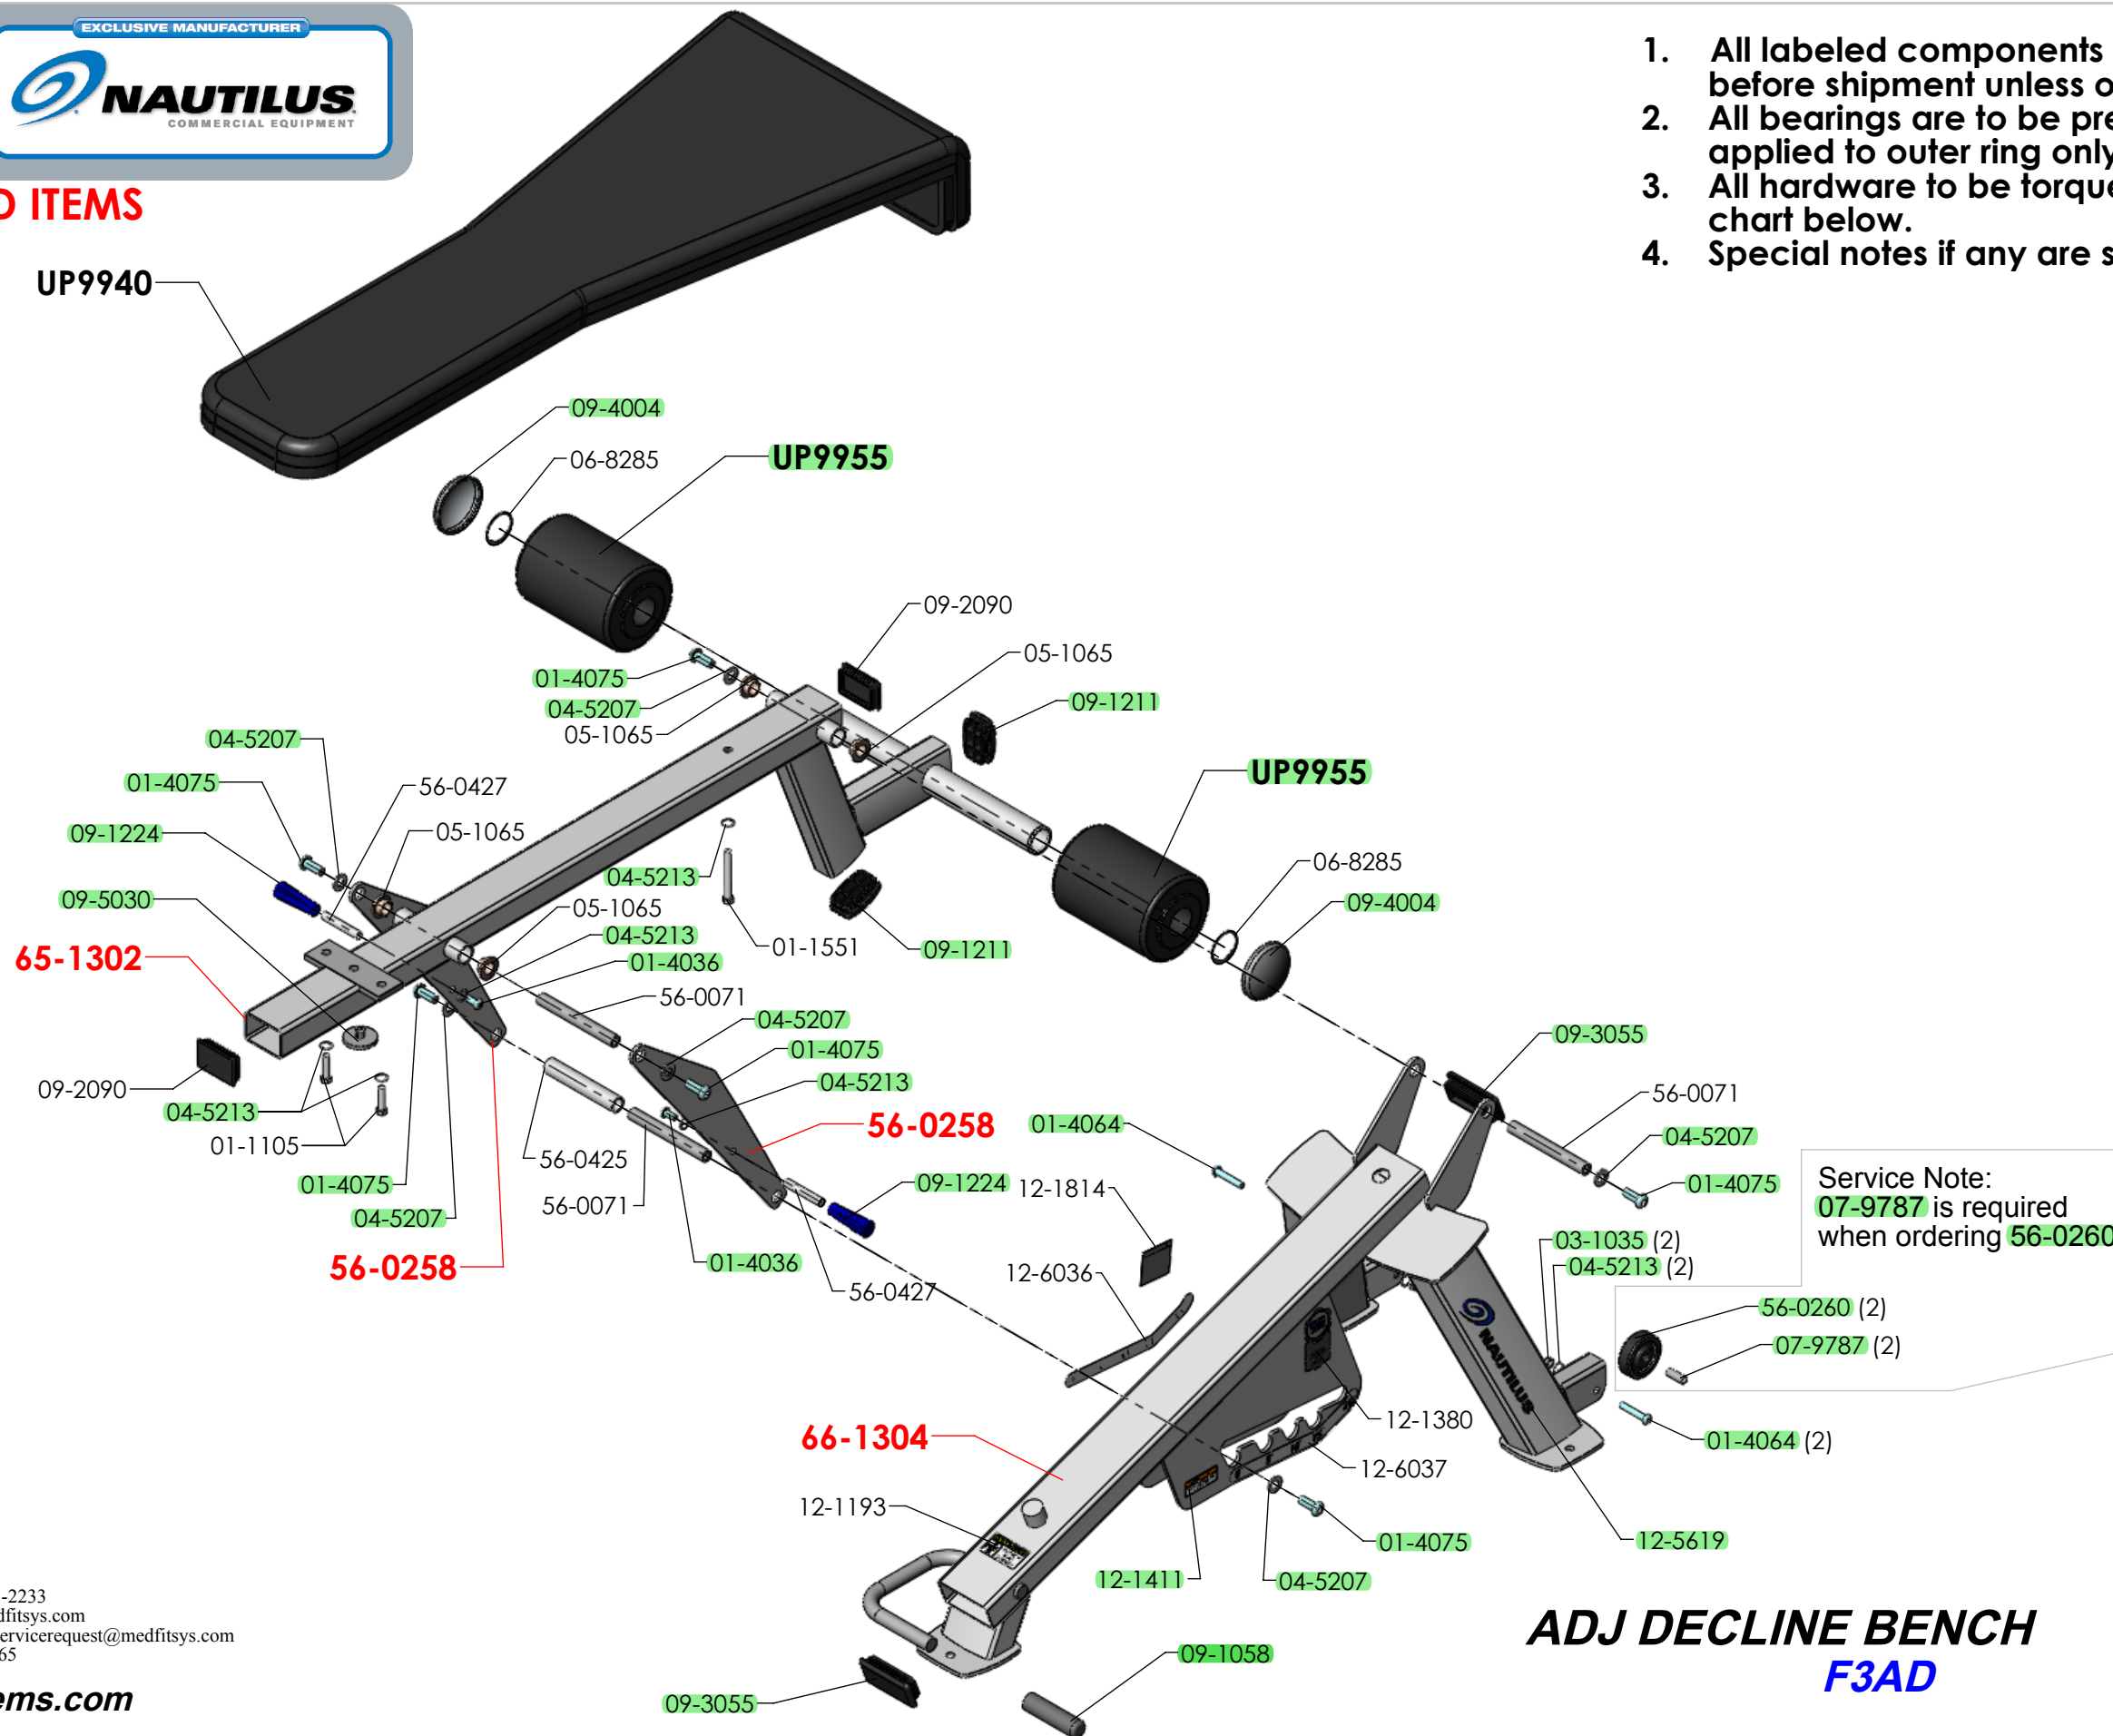

1. All labeled components are to be assembled before shipment unless otherwise noted.
2. All bearings are to be pressed in with force applied to outer ring only.
3. All hardware to be torqued to specs listed in chart below.
4. Special notes if any are shown below.


Customer Service & Parts 800/ 235-2233
General Parts Requests: parts@medfitsys.com
Warranty Field Service Requests: servicerequest@medfitsys.com
Med-Fit Systems, Inc. 800/ 831-7665

www.medfitsystems.com

ADJ DECLINE BENCH F3AD

Bolt Torque Specifications		
Size	Grade 5	Grade 8
	Torque (ft-lbs)	Torque (ft-lbs)
1/4-20	8	12
1/4-28	10	14
5/16-18	17	25
3/8-16	30	45
7/16-14	50	70
1/2-13	75	110
1/2-20	90	120
5/8-11	150	220
5/8-18	180	240

REV F

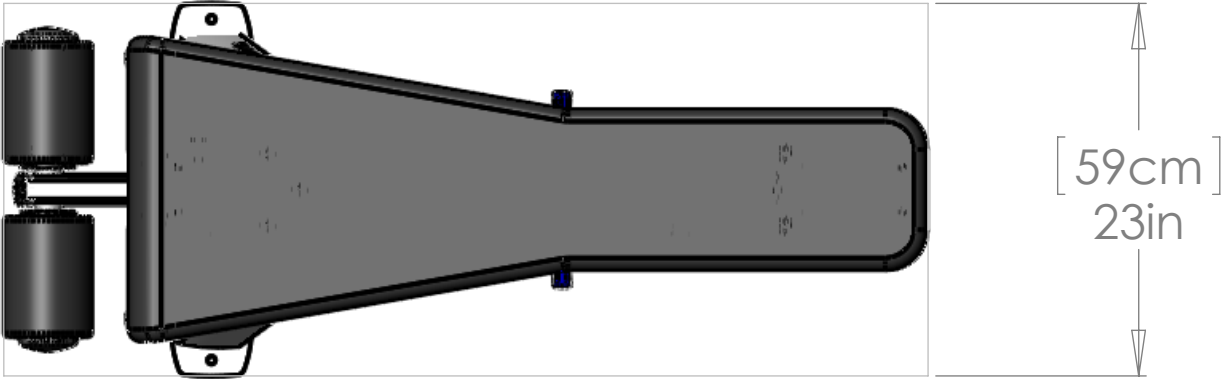

10/5/12	F3AD
<u>Units</u>	<u>Weight</u>
lbs	120
kg	54

